



NOTE:

- 1.0 THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT DRAWINGS AND SCHEDULES
- 2.0 ALLOWABLE BEARING PRESSURE TO ALL FOUNDATIONS IS 75kPa. CONTRACTOR TO ALLOW FOR TESTING.
- 3.0 CONCRETE STRENGTH TO BE AS FOLLOWS: FOOTINGS, SURFACE BEDS, – 20MPa, SUSPENDED SLABS, BEAMS – 25MPa
- 4.0 COVER TO ALL REINFORCEMENT SHALL BE AS FOLLOWS: FOUNDATIONS – 50mm, BEAMS – 30mm, SLABS – 25mm.
- 5.0 NO CONCRETE SHALL BE POURED WITHOUT THE ENGINEER’S APPROVAL

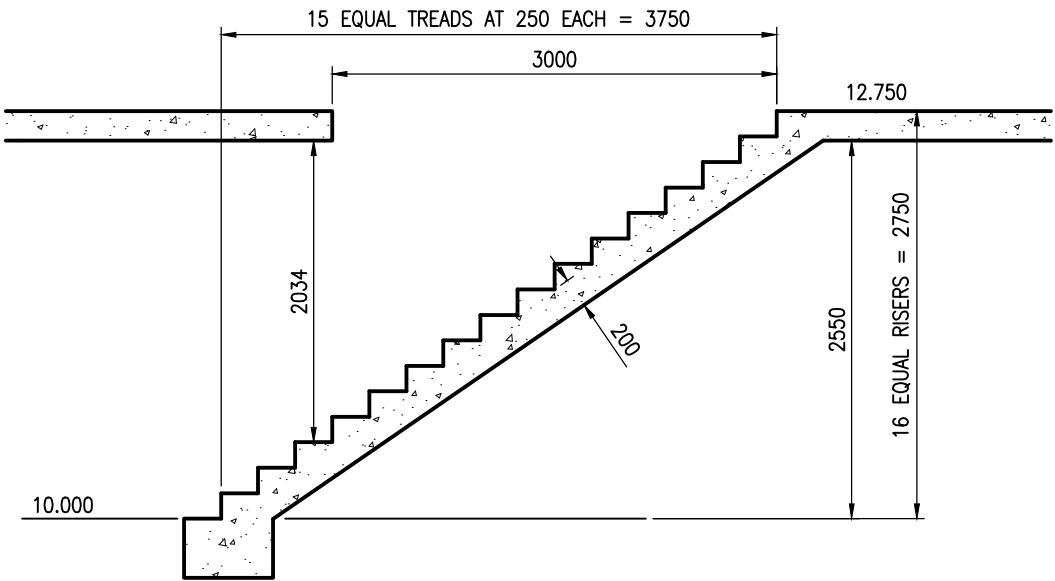

STAIR LONG-SECTION
1:50

HOUSE MULEYA
PROPOSED MAIN HOUSE ON
ERF 6520 BONZA VIEWS, EAST LONDON
DWG No. 1910-03
FIRST FLOOR LAYOUT
JUNE 2019

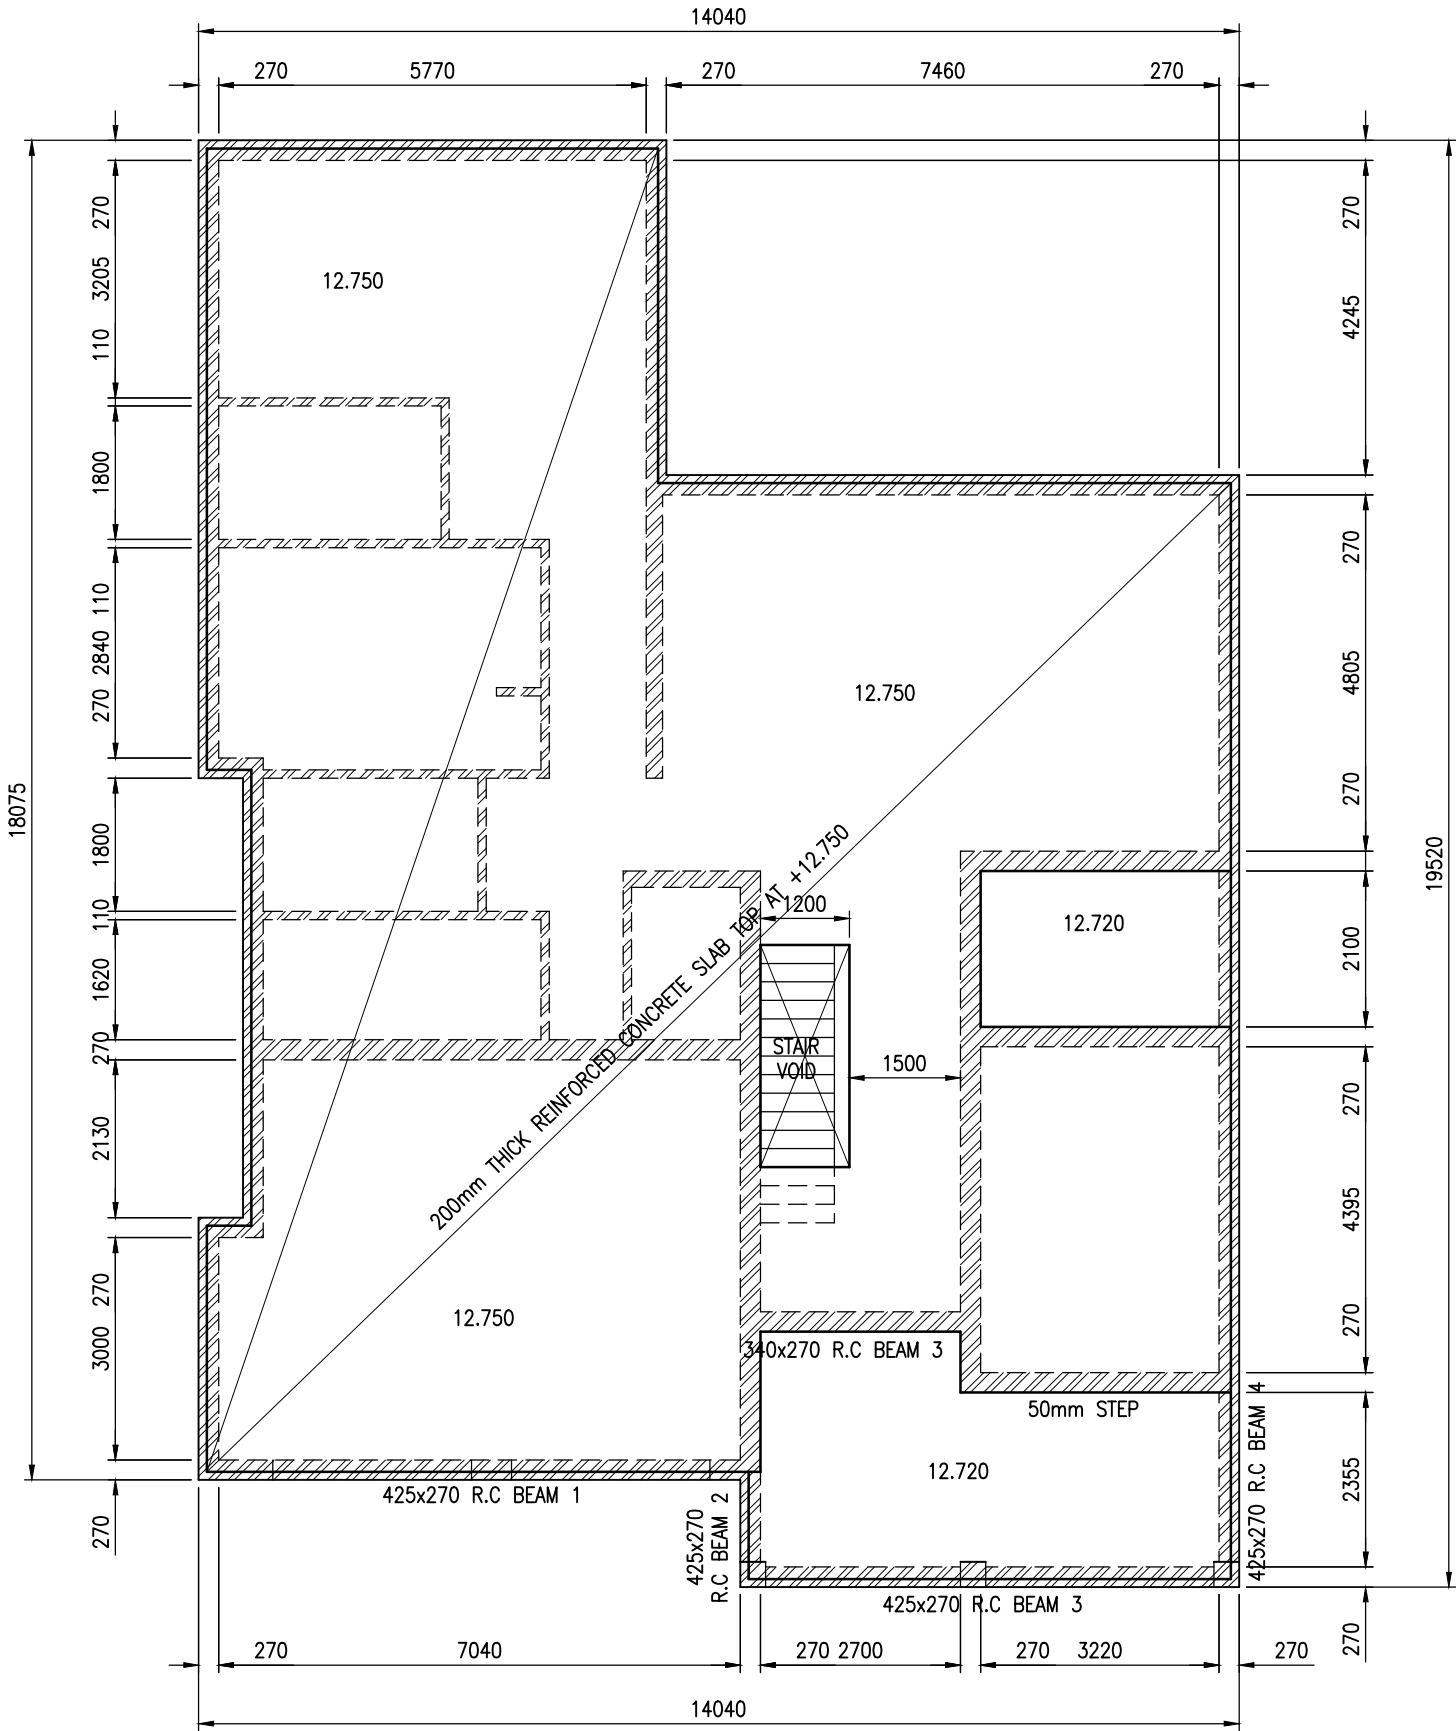

FIRST FLOOR LAYOUT
1:100